

WIRING DIAGRAM

For 80+ and 90+ Single Stage Furnaces

Refer to the Installation Instructions provided with the furnace for the proper heating and cooling speeds for your application.

Red LED Flash	Error/Condition
1	Flash codes stored in memory (auto-erased after 14 days)
2	System Lockout (Retries Exceeded)
3	Pressure Switch Stuck Closed
4	Pressure Switch Stuck Open
5	Open High Temperature Limit Switch
6	Flame Sensed > 4.25 Seconds with Gas Valve De-Energized
8	Open Flame RO Switch
10	Ignitor Relay Error
11	Open Fuse
12	Inducer Relay Error
Flash codes NOT stored in memory	
7	Low Flame Sense Signal
9	Twining Fault
Off	Control Failure / No Power / Internal Fault / IRQ Loss
	Gas Heating Lockout (Gas valve energized when it should be de-energized)
	Or Gas valve De-energized when it should be Energized
Rapid Flash	Reverse Polarity
Continuous On	Normal Operation

If any of the original wire as supplied with the furnace must be replaced, it must be replaced with wiring material having a temperature of at least 105° C.

Use copper conductors only.


Cool Motor SPEED DIPSWITCH SETTING (S1-1, S1-2, S1-3)													
	Position	1	2	3	1	2	3	1	2	3	1	2	3
Motor SPEED Cool	Y	T1	T2	T3	T4	T1+T2	T1	T1	T1	T1	T1	T1	T1

Heat Motor SPEED DIPSWITCH SETTING (S2-1, S2-2)					
		1 2	1 2	1 2	1 2
	Position	OFF OFF	ON OFF	ON ON	OFF ON
Motor SPEED Heat	W	T1	T2	T3	T4

Fan Motor SPEED DIPSWITCH SETTING (S2-3, S2-4)							
		1	2	1	2	1	2
	Position	OFF	OFF	ON	OFF	OFF	ON
Motor SPEED Fan	G	T1		T2		T4	T1+T2

LEGEND:

FIELD WIRING - - - - -
LOW VOLTAGE ————
HIGH VOLTAGE ————

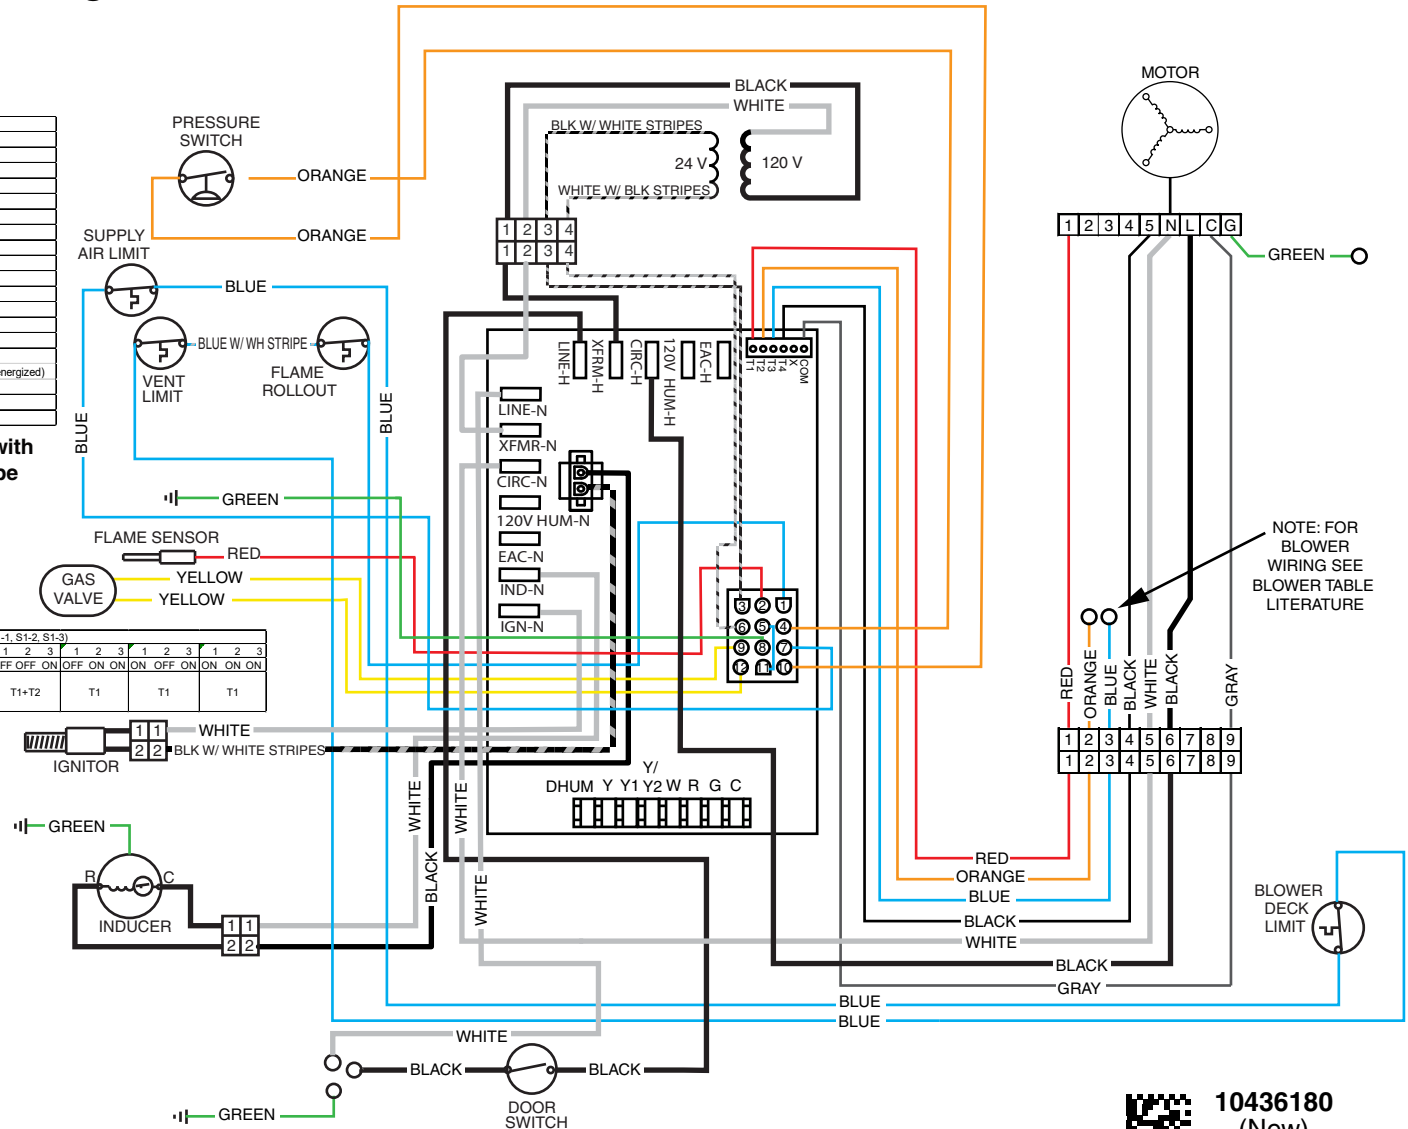

10436180
(New)
06/22