

USER'S INFORMATION AND INSTALLATION INSTRUCTIONS

Duct Connector and A/C Coil Box Preparations for use with M4RL

For use with downflow installations having a Coil Box (920171 or 920261) paired with a Duct Connector (901987 through 901993).

Read these instructions entirely previous to installation of the duct connector (P/N 901987 through 901993):

1. Before securing duct connector to the floor, install plates included with M4RL unit. Refer to Figure 1 for placement.
2. Be sure the holes in the plates line up with the holes in the duct connector. The plates should be placed on the left and right sides of the duct connector.
3. Refer to Installation Instructions for the remainder of the duct connector installation.

Read these instructions entirely previous to installation of the A/C coil box (P/N 920171 or 920261) and downflow furnace:

1. Remove screws (2) from the front bottom portion of the A/C coil box. Refer to Figure 2 for location.
2. Place close-off plate on under side of A/C coil box, lining up the holes from the close-off plate with the empty holes in the coil box.
3. Replace screws (2) into holes, securing close-off plate to the A/C coil box.
4. Refer to Installation Instructions for the remainder of the coil box and downflow furnace installation.

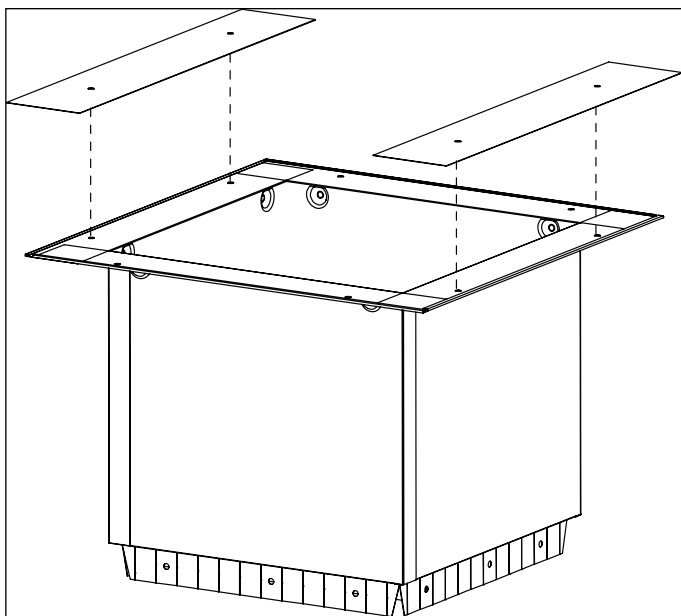


Figure 1. Duct Connector Preparation

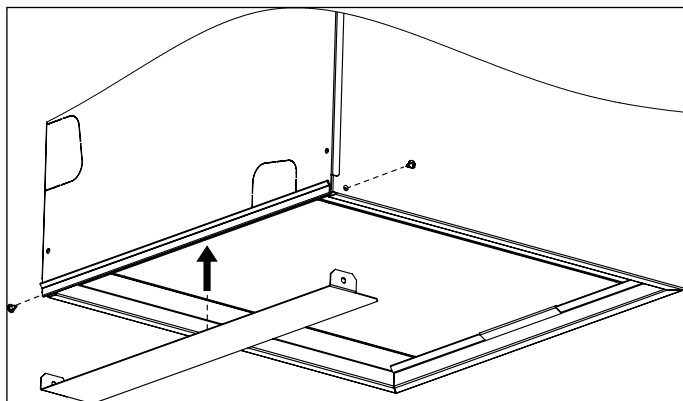


Figure 2. Coil Box Preparation



7089280