FRIGIDAIRE



Delivering Comfort

WITH THE **FG7TE-FS SERIES** OF GAS FURNACES

Table of Contents

2 CONTRACTOR SUPPORT

3 PRODUCT FEATURES & BENEFITS

4 TECHNICAL SPECIFICATIONS

- MODEL ID CODES

- VENTING

5 SPECIFICATIONS

6 LOCATION OF FURNACE COMPONENTS AND DIMENSIONS

7 BLOWER PERFORMANCE

12 ACCESSORIES





THE FRIGIDAIRE®


TOTAL PACKAGE™

Designed with contractors in mind. Frigidaire HVAC equipment is designed with the contractor in mind. Each unit is equipped with features designed to make them easier to install and service, reducing time spent on each job while ensuring peak performance and safety.

EASY TO Service

EASY TO Install

SmartLite®
CONTROL BOARD

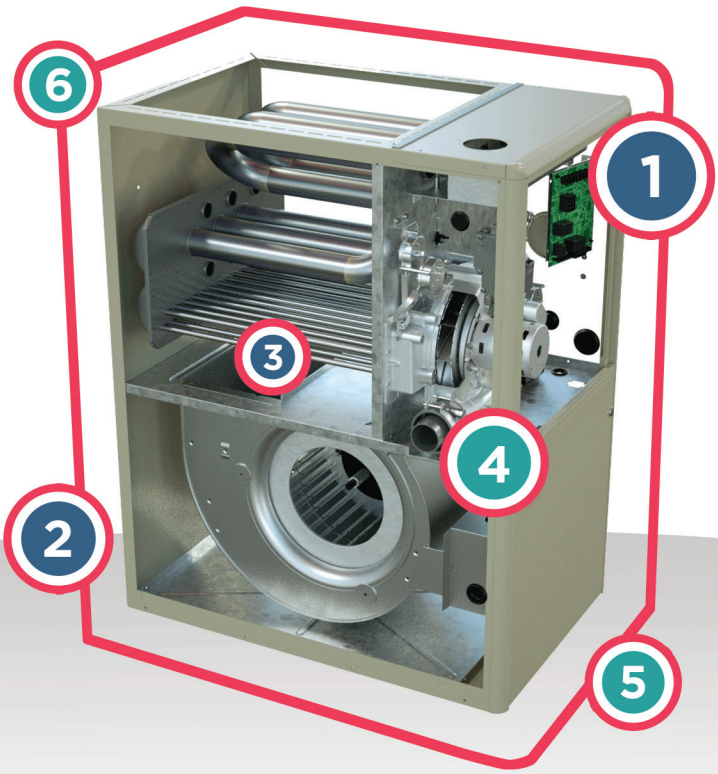

FG7TE-FS Series

Two Stage, Fixed Speed Gas Furnaces | Up to 96% AFUE | High Efficiency Dedicated Upflow

The FG7TE-FS Series of furnaces offers exceptional performance.
This high efficiency upflow gas furnace may be installed free standing in a utility room, basement, or enclosed in an alcove or closet. The extended flush jacket provides a pleasing "appliance appearance."

Easy to Service

① REMOVABLE SIDE PANELS
Side panels can be easily removed and replaced without removing the top grill.

② COLOR CODED WIRE HARNESS
Utilizes quick-connect fittings for ease of service and component replacement.

③ GALVANIZED STEEL EXTERIOR
Powder-coated paint and gloss finish eliminates sharp edges and reduces scratching.


Easy to Install

④ QR CODES
QR codes on each unit link directly to the product's technical literature, eliminating the need to search for relevant documentation when working on the unit.

⑤ HIGH STATIC BLOWERS
All models equipped with high static blowers.

⑥ LOW BOY HEIGHT
Easy to apply in low ceiling applications, works well with taller high SEER2 coils, easier to handle and install.

MODEL ID
CODES

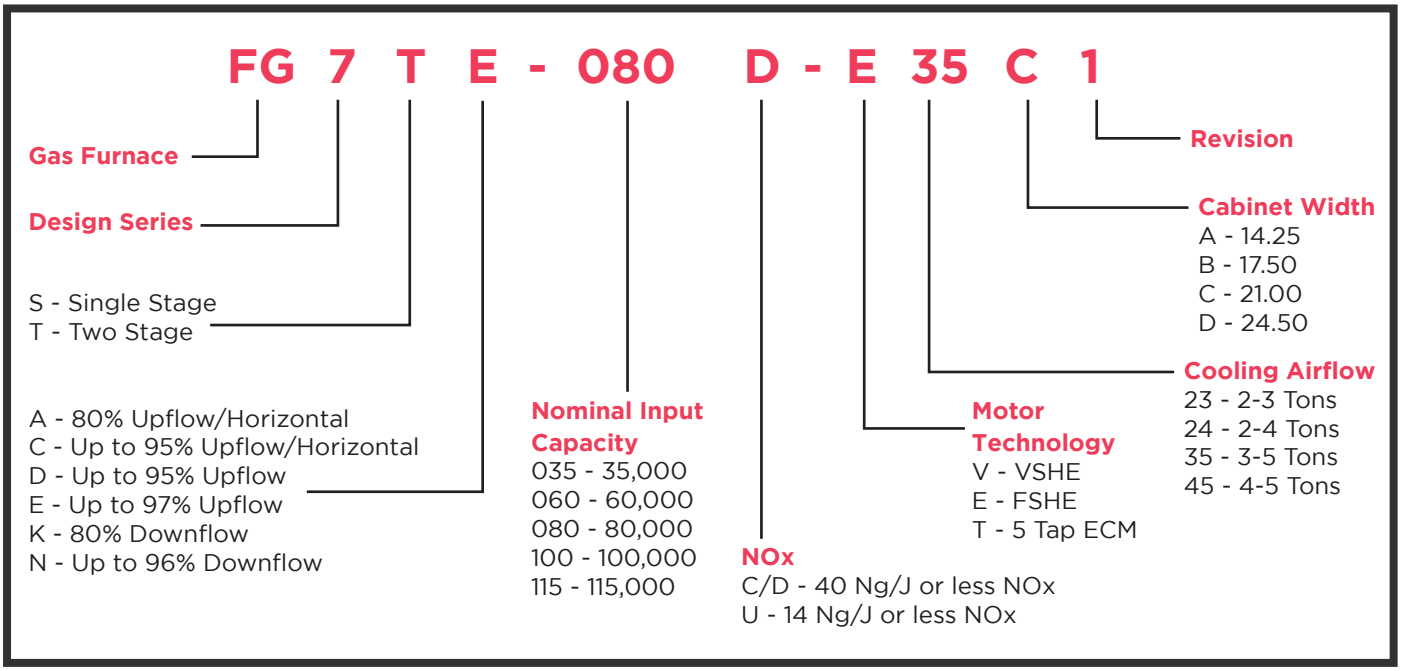

VENTING

All models are approved for vertical non direct (1 pipe) and direct (2 pipe) venting applications. See Vent Table below for specified sizes and allowable lengths.

FURNACE MODELS (BTU)	FURNACE INSTALLATION	SINGLE VENT PIPE LENGTH (ft.) with 1 long radius elbow*		DUAL VENT PIPE LENGTH (ft.) with 1 long radius elbow on each pipe*	
		OUTLET 2" Diameter	OUTLET 3" Diameter	INLET/OUTLET 2" Diameter	INLET/OUTLET 3" Diameter
35,000	Upflow	60	90	60	90
60,000	Upflow	60	90	60	90
80,000	Upflow	40	90	40	90
100,000	Upflow	30	90	30	90
115,000	Upflow	N/A	90	N/A	90

***NOTES:**

1. Subtract 2.5 ft. for each additional 2 inch long radius elbow, 5 ft. for each additional 2 inch short radius elbow, 3.5 ft. for each additional 3 inch long radius elbow, and 7 ft. for each additional 3 inch short radius elbow. Subtract 5 ft for each 2" tee and 8 ft for each 3" tee. Two 45 degree elbows are equivalent to one 90 degree elbow.
2. This table applies for elevations from sea level to 2,000 ft. For higher elevations, decrease pipe lengths by 8% per 1,000 ft of altitude.


SPECIFICATIONS

FG7TE MODEL NUMBERS	-035D-E23A1	-060D-E24B1	-080D-E35C1	-100D-E35C1	-115D-E45D1
Input - Btuh (a)	35000/23000	60000/39000	80000/52000	100000/65000	115000/74750
Heating Capacity - BtuH	33000/22000	58000/37000	77000/50000	96000/62000	110000/72000
AFUE	96.0	96.0	96.0	96.0	96.0
Motor H.P. - Speed - Type	1/2 - BLDC	3/4 - BLDC	1 - BLDC	1 - BLDC	1 - BLDC
Motor FLA	6.9	8.8	11.5	11.5	11.5
Rated Ext. SP - In. W.C.	0.5	0.5	0.5	0.5	0.5
Temperature Rise Range - °F	30-60	30-60	30-60	35-65	40-70
Shipping Weights (lbs)	101	120	130	135	145

NOTE:
All models are 115V, 60 Hz. Gas Connections are 1/2" N.P.T.
(a) Ratings to 2,000 ft. Over 2,000 ft. reduce 4% for each 1,000 ft. above sea level.

LOCATION OF FURNACE COMPONENTS


UPFLOW FURNACE (*TE SERIES)

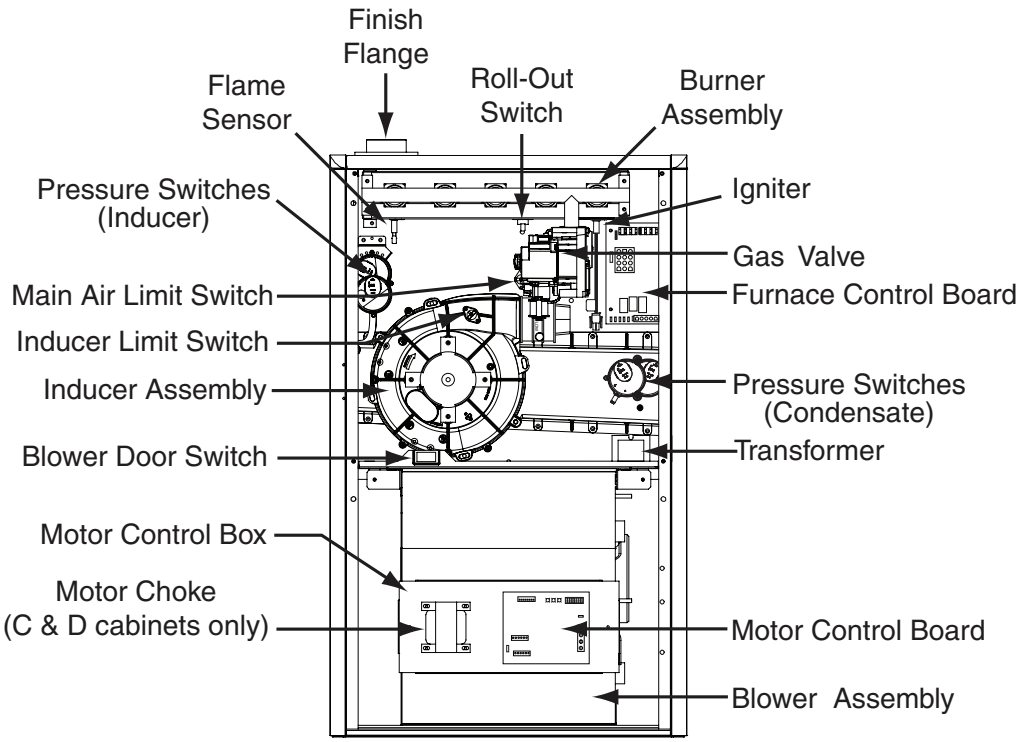



DIMENSIONS


Model FG7TE	Dimension "A"	Dimension "B"	Dimension "C"
'A' Cabinet	14 1/4	12 5/8	12 7/8
'B' Cabinet	17 1/2	15 7/8	16 1/8
'C' Cabinet	21	19 3/8	19 5/8
'D' Cabinet	24 1/2	22 7/8	23 1/8


NOTE: Dimensions shown in inches

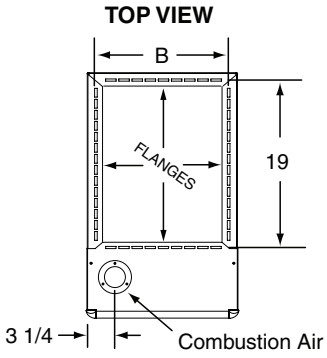

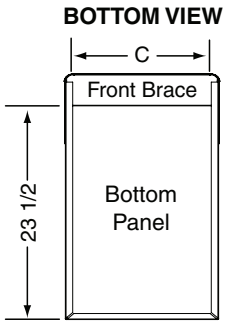

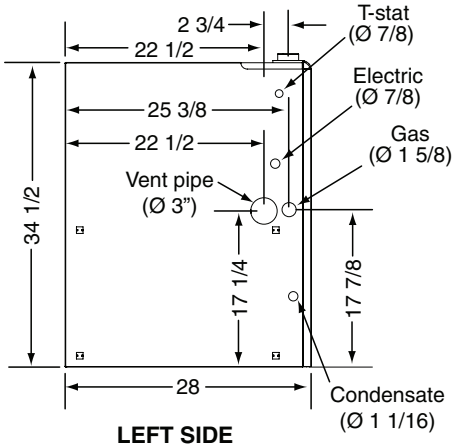

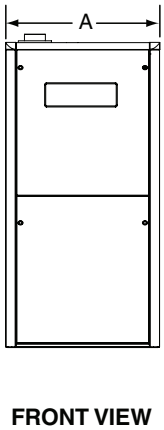

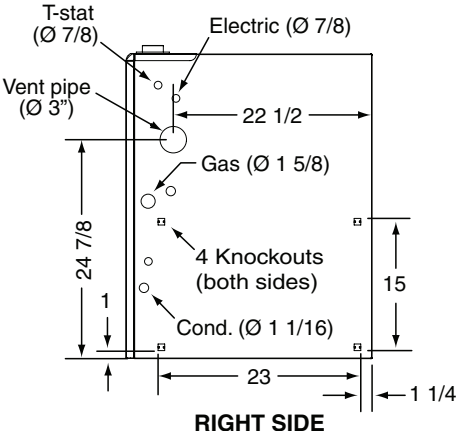

BLOWER PERFORMANCE

HEATING AIRFLOW (CFM) & TEMPERATURE RISE (°F)																
Model Number/ Heating Input	MOTOR SWITCH SETTINGS (0=OFF, 1=ON)				External Static Pressure (in.w.c.)											
					0.1		0.2		0.3		0.4		0.5			
	1	2	3	4	CFM	RISE	CFM	RISE	CFM	RISE	CFM	RISE	CFM	RISE		
G7TE-035D-E23A1 35,000 BTU/hr	0	0	0	0												
	1	0	0	0	560	56	515	60								
	0	1	0	0	570	55	540	58								
	1	1	0	0	670	46	635	49	595	52	565	55	525	59		
	0	0	1	0	700	44	670	46	635	49	600	52	565	55		
	1	0	1	0	765	41	725	43	690	45	660	47	625	50		
	0	1	1	0	795	39	755	41	720	43	690	45	650	48		
	1	1	1	0	845	37	810	38	775	40	740	42	705	44		
	0	0	0	1	895	35	860	36	825	38	790	39	760	41		
	1	0	0	1	905	34	870	36	840	37	805	39	770	40		
	0	1	0	1	950	33	920	34	885	35	850	37	820	38		
	1	1	0	1	990	31	955	33	925	34	890	35	860	36		
	0	0	1	1	1010	31	980	32	945	33	910	34	885	35		
	1	0	1	1	1050	30	1015	31	985	32	955	33	925	34		
	0	1	1	1			1045	30	1020	31	990	31	960	32		
	1	1	1	1												

COOLING AIRFLOW (CFM)														
Model Number/ Heating Input	MOTOR SWITCH SETTINGS (0=OFF, 1=ON)				External Static Pressure (in.w.c.)									
					0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8		
	5	6	7	8	CFM	CFM	CFM	CFM	CFM	CFM	CFM	CFM		
G7TE-035D-E23A1 35,000 BTU/hr	0	0	0	0										
	1	0	0	0	560	515	475							
	0	1	0	0	570	540	505	460						
	1	1	0	0	670	635	595	565	525	485				
	0	0	1	0	700	670	635	600	565	530	485			
	1	0	1	0	765	725	690	660	625	585	550	510		
	0	1	1	0	795	755	720	690	650	615	580	545		
	1	1	1	0	845	810	775	740	705	675	640	600		
	0	0	0	1	895	860	825	790	760	725	695	660		
	1	0	0	1	905	870	840	805	770	740	700	670		
	0	1	0	1	950	920	885	850	820	785	760	720		
	1	1	0	1	990	955	925	890	860	830	800	765		
	0	0	1	1	1010	980	945	910	885	850	820	790		
	1	0	1	1	1050	1015	985	955	925	895	865	830		
	0	1	1	1	1080	1045	1020	990	960	930	895	865		
	1	1	1	1	1105	1075	1045	1015	985	955	920	895		

NOTES:

1. Motor switch settings for heating speeds use HEAT switches 1, 2, 3, & 4 and for cooling speeds use COOL switches 5, 6, 7, & 8.
2. To comply with government mandated efficiency standards, two openings are required for airflows above 1,600 CFM.
3. Data is shown without filter.
4. Temperature rises in the table are approximate. Actual temperature rises may vary.
5. Individual cells shaded in gray indicate a temperature rise outside of the recommended range.
6. To comply with government mandated efficiency standards, speed settings shaded in gray are not allowed in HEAT mode.
7. When in low stage heat, the airflow is approximately 70% of the tables high value (2-stage furnaces only).

BLOWER PERFORMANCE CONTINUED

HEATING AIRFLOW (CFM) & TEMPERATURE RISE (°F)																
Model Number/ Heating Input	MOTOR SWITCH SETTINGS (0=OFF, 1=ON)				External Static Pressure (in.w.c.)											
					0.1		0.2		0.3		0.4		0.5			
	1	2	3	4	CFM	RISE	CFM	RISE	CFM	RISE	CFM	RISE	CFM	RISE		
G7TE-060D-E24B1 60,000 BTU/hr	0	0	0	0												
	1	0	0	0												
	0	1	0	0												
	1	1	0	0												
	0	0	1	0												
	1	0	1	0	940	57	890	60								
	0	1	1	0	990	54	945	56	905	59						
	1	1	1	0	1,055	51	1,015	53	970	55	930	57	890	60		
	0	0	0	1	1,135	47	1,095	49	1,055	51	1,010	53	960	56		
	1	0	0	1	1,185	45	1,145	47	1,105	48	1,065	50	1,030	52		
	0	1	0	1	1,250	43	1,210	44	1,170	46	1,135	47	1,095	49		
	1	1	0	1	1,290	41	1,255	42	1,220	44	1,180	45	1,145	47		
	0	0	1	1	1,315	41	1,275	42	1,240	43	1,200	44	1,160	46		
	1	0	1	1	1,350	40	1,315	41	1,280	42	1,245	43	1,205	44		
	0	1	1	1	1,390	38	1,350	40	1,315	41	1,275	42	1,240	43		
	1	1	1	1												

COOLING AIRFLOW (CFM)														
Model Number/ Heating Input	MOTOR SWITCH SETTINGS (0=OFF, 1=ON)				External Static Pressure (in.w.c.)									
					0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8		
	5	6	7	8	CFM	CFM	CFM	CFM	CFM	CFM	CFM	CFM		
G7TE-060D-E24B1 60,000 BTU/hr	0	0	0	0										
	1	0	0	0										
	0	1	0	0										
	1	1	0	0	725									
	0	0	1	0	810									
	1	0	1	0	940	890	845	795	750	700				
	0	1	1	0	990	945	905	860	820	775	735	690		
	1	1	1	0	1,055	1,015	970	930	890	845	805	760		
	0	0	0	1	1,135	1,095	1,055	1,010	960	930	890	850		
	1	0	0	1	1,185	1,145	1,105	1,065	1,030	990	950	910		
	0	1	0	1	1,250	1,210	1,170	1,135	1,095	1,055	1,020	980		
	1	1	0	1	1,290	1,255	1,220	1,180	1,145	1,110	1,075	1,040		
	0	0	1	1	1,315	1,275	1,240	1,200	1,160	1,120	1,085	1,045		
	1	0	1	1	1,350	1,315	1,280	1,245	1,205	1,170	1,135	1,100		
	0	1	1	1	1,390	1,350	1,315	1,275	1,240	1,200	1,160	1,125		
	1	1	1	1	1,420	1,380	1,345	1,310	1,270	1,235	1,200	1,160		

NOTES:

1. Motor switch settings for heating speeds use HEAT switches 1, 2, 3, & 4 and for cooling speeds use COOL switches 5, 6, 7, & 8.
2. To comply with government mandated efficiency standards, two openings are required for airflows above 1,600 CFM.
3. Data is shown without filter.
4. Temperature rises in the table are approximate. Actual temperature rises may vary.
5. Individual cells shaded in gray indicate a temperature rise outside of the recommended range.
6. To comply with government mandated efficiency standards, speed settings shaded in gray are not allowed in HEAT mode.
7. When in low stage heat, the airflow is approximately 70% of the tables high value (2-stage furnaces only).

BLOWER PERFORMANCE CONTINUED

HEATING AIRFLOW (CFM) & TEMPERATURE RISE (°F)																
Model Number/ Heating Input	MOTOR SWITCH SETTINGS (0=OFF, 1=ON)				External Static Pressure (in.w.c.)											
					0.1		0.2		0.3		0.4		0.5			
	1	2	3	4	CFM	RISE	CFM	RISE	CFM	RISE	CFM	RISE	CFM	RISE		
FG7TE-080D-E35C1 80,000 BTU/hr	0	0	0	0	1,125	63										
	1	0	0	0	1,205	59	1,120	63								
	0	1	0	0	1,305	54	1,225	58	1,150	62						
	1	1	0	0	1,430	50	1,350	53	1,270	56	1,190	60	1,110	63		
	0	0	1	0	1,525	47	1,450	49	1,375	52	1,300	55	1,225	57		
	1	0	1	0	1,620	44	1,540	46	1,465	49	1,390	51	1,315	54		
	0	1	1	0	1,695	42	1,620	44	1,545	46	1,465	49	1,390	51		
	1	1	1	0	1,770	40	1,700	42	1,630	44	1,555	46	1,485	47		
	0	0	0	1	1,875	38	1,805	39	1,730	41	1,655	43	1,580	45		
	1	0	0	1	1,905	37	1,840	39	1,775	40	1,710	42	1,640	43		
	0	1	0	1	1,980	36	1,910	37	1,845	39	1,780	40	1,715	41		
	1	1	0	1	2,025	35	1,960	36	1,895	38	1,830	39	1,765	40		
	0	0	1	1			2,025	35	1,960	36	1,900	37	1,840	38		
	1	0	1	1					2,010	35	1,945	37	1,880	37		
	0	1	1	1							2,035	35	1,980	36		
	1	1	1	1												

COOLING AIRFLOW (CFM)													
Model Number/ Heating Input	MOTOR SWITCH SETTINGS (0=OFF, 1=ON)				External Static Pressure (in.w.c.)								
					0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	
	5	6	7	8	CFM	CFM	CFM	CFM	CFM	CFM	CFM	CFM	
FG7TE-080D-E35C1 80,000 BTU/hr	0	0	0	0	1,125	1,040	960	880	795				
	1	0	0	0	1,205	1,120	1,040	960	875	795			
	0	1	0	0	1,305	1,225	1,150	1,070	995	915	840		
	1	1	0	0	1,430	1,350	1,270	1,190	1,110	1,030	950	865	
	0	0	1	0	1,525	1,450	1,375	1,300	1,225	1,150	1,075	1,000	
	1	0	1	0	1,620	1,540	1,465	1,390	1,315	1,240	1,165	1,090	
	0	1	1	0	1,695	1,620	1,545	1,465	1,390	1,315	1,235	1,160	
	1	1	1	0	1,770	1,700	1,630	1,555	1,485	1,410	1,340	1,265	
	0	0	0	1	1,875	1,805	1,730	1,655	1,580	1,510	1,435	1,340	
	1	0	0	1	1,905	1,840	1,775	1,710	1,640	1,575	1,510	1,445	
	0	1	0	1	1,980	1,910	1,845	1,780	1,715	1,650	1,580	1,515	
	1	1	0	1	2,025	1,960	1,895	1,830	1,765	1,700	1,635	1,570	
	0	0	1	1	2,085	2,025	1,960	1,900	1,840	1,775	1,715	1,655	
	1	0	1	1	2,135	2,070	2,010	1,945	1,880	1,815	1,750	1,685	
	0	1	1	1	2,200	2,145	2,090	2,035	1,980	1,925	1,870	1,820	
	1	1	1	1	2,280	2,225	2,170	2,115	2,065	2,010	1,955	1,900	

NOTES:

1. Motor switch settings for heating speeds use HEAT switches 1, 2, 3, & 4 and for cooling speeds use COOL switches 5, 6, 7, & 8.
2. To comply with government mandated efficiency standards, two openings are required for airflows above 1,600 CFM.
3. Data is shown without filter.
4. Temperature rises in the table are approximate. Actual temperature rises may vary.
5. Individual cells shaded in gray indicate a temperature rise outside of the recommended range.
6. To comply with government mandated efficiency standards, speed settings shaded in gray are not allowed in HEAT mode.
7. When in low stage heat, the airflow is approximately 70% of the tables high value (2-stage furnaces only).

BLOWER PERFORMANCE CONTINUED

HEATING AIRFLOW (CFM) & TEMPERATURE RISE (°F)																
Model Number/ Heating Input	MOTOR SWITCH SETTINGS (0=OFF, 1=ON)				External Static Pressure (in.w.c.)											
					0.1		0.2		0.3		0.4		0.5			
	1	2	3	4	CFM	RISE	CFM	RISE	CFM	RISE	CFM	RISE	CFM	RISE		
FG7TE-100D-E35C1 100,000 BTU/hr	0	0	0	0												
	1	0	0	0												
	0	1	0	0												
	1	1	0	0												
	0	0	1	0												
	1	0	1	0	1,620	55	1,540	58								
	0	1	1	0	1,695	52	1,620	55	1,545	58						
	1	1	1	0	1,770	50	1,700	52	1,630	55	1,555	57	1,485	60		
	0	0	0	1	1,875	47	1,805	49	1,730	51	1,655	54	1,580	56		
	1	0	0	1	1,905	47	1,840	48	1,775	50	1,710	52	1,640	54		
	0	1	0	1	1,980	45	1,910	47	1,845	48	1,780	50	1,715	52		
	1	1	0	1	2,025	44	1,960	45	1,895	47	1,830	49	1,765	50		
	0	0	1	1	2,085	43	2,025	44	1,960	45	1,900	47	1,840	48		
	1	0	1	1	2,135	42	2,070	43	2,010	44	1,945	46	1,880	47		
	0	1	1	1												
	1	1	1	1												

COOLING AIRFLOW (CFM)														
Model Number/ Heating Input	MOTOR SWITCH SETTINGS (0=OFF, 1=ON)				External Static Pressure (in.w.c.)									
					0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8		
	5	6	7	8	CFM	CFM	CFM	CFM	CFM	CFM	CFM	CFM		
FG7TE-100D-E35C1 100,000 BTU/hr	0	0	0	0	1,125	1,040								
	1	0	0	0	1,205	1,120	1,040							
	0	1	0	0	1,305	1,225	1,150	1,070	995					
	1	1	0	0	1,430	1,350	1,270	1,190	1,110	1,030				
	0	0	1	0	1,525	1,450	1,375	1,300	1,225	1,150	1,075	1,000		
	1	0	1	0	1,620	1,540	1,465	1,390	1,315	1,240	1,165	1,090		
	0	1	1	0	1,695	1,620	1,545	1,465	1,390	1,315	1,235	1,160		
	1	1	1	0	1,770	1,700	1,630	1,555	1,485	1,410	1,340	1,265		
	0	0	0	1	1,875	1,805	1,730	1,655	1,580	1,510	1,435	1,340		
	1	0	0	1	1,905	1,840	1,775	1,710	1,640	1,575	1,510	1,445		
	0	1	0	1	1,980	1,910	1,845	1,780	1,715	1,650	1,580	1,515		
	1	1	0	1	2,025	1,960	1,895	1,830	1,765	1,700	1,635	1,570		
	0	0	1	1	2,085	2,025	1,960	1,900	1,840	1,775	1,715	1,655		
	1	0	1	1	2,135	2,070	2,010	1,945	1,880	1,815	1,750	1,685		
	0	1	1	1	2,200	2,145	2,090	2,035	1,980	1,925	1,870	1,820		
	1	1	1	1	2,280	2,225	2,170	2,115	2,065	2,010	1,955	1,900		

NOTES:

1. Motor switch settings for heating speeds use HEAT switches 1, 2, 3, & 4 and for cooling speeds use COOL switches 5, 6, 7, & 8.
2. To comply with government mandated efficiency standards, two openings are required for airflows above 1,600 CFM.
3. Data is shown without filter.
4. Temperature rises in the table are approximate. Actual temperature rises may vary.
5. Individual cells shaded in gray indicate a temperature rise outside of the recommended range.
6. To comply with government mandated efficiency standards, speed settings shaded in gray are not allowed in HEAT mode.
7. When in low stage heat, the airflow is approximately 70% of the tables high value (2-stage furnaces only).

BLOWER PERFORMANCE CONTINUED

HEATING AIRFLOW (CFM) & TEMPERATURE RISE (°F)																
Model Number/ Heating Input	MOTOR SWITCH SETTINGS (0=OFF, 1=ON)				External Static Pressure (in.w.c.)											
					0.1		0.2		0.3		0.4		0.5			
	1	2	3	4	CFM	RISE	CFM	RISE	CFM	RISE	CFM	RISE	CFM	RISE		
FG7TE-115D-E45D1 115,000 BTU/hr	0	0	0	0												
	1	0	0	0												
	0	1	0	0												
	1	1	0	0												
	0	0	1	0												
	1	0	1	0	1,760	58	1,715	60								
	0	1	1	0	1,835	56	1,790	57	1,745	59						
	1	1	1	0	1,885	54	1,840	56	1,790	57	1,745	59	1,700	60		
	0	0	0	1	1,945	53	1,900	54	1,850	55	1,805	57	1,760	58		
	1	0	0	1	1,950	52	1,905	54	1,860	55	1,820	56	1,775	58		
	0	1	0	1	2,075	49	2,030	50	1,990	51	1,945	53	1,900	54		
	1	1	0	1	2,125	48	2,085	49	2,040	50	2,000	51	1,955	52		
	0	0	1	1	2,170	47	2,130	48	2,090	49	2,045	50	2,005	51		
	1	0	1	1	2,215	46	2,180	47	2,140	48	2,105	49	2,070	49		
	0	1	1	1												
	1	1	1	1												

COOLING AIRFLOW (CFM)												
Model Number/ Heating Input	MOTOR SWITCH SETTINGS (0=OFF, 1=ON)				External Static Pressure (in.w.c.)							
					0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
	5	6	7	8	CFM	CFM	CFM	CFM	CFM	CFM	CFM	CFM
FG7TE-115D-E45D1 115,000 BTU/hr	0	0	0	0	1,395	1,350	1,305	1,260	1,210	1,165	1,120	
	1	0	0	0	1,465	1,420	1,375	1,330	1,290	1,245	1,200	1,155
	0	1	0	0	1,555	1,510	1,470	1,425	1,380	1,340	1,295	1,250
	1	1	0	0	1,625	1,585	1,540	1,500	1,460	1,415	1,375	1,335
	0	0	1	0	1,690	1,650	1,610	1,570	1,530	1,485	1,445	1,405
	1	0	1	0	1,760	1,715	1,670	1,625	1,575	1,530	1,485	1,440
	0	1	1	0	1,835	1,790	1,745	1,695	1,650	1,605	1,555	1,510
	1	1	1	0	1,885	1,840	1,790	1,745	1,700	1,655	1,610	1,565
	0	0	0	1	1,945	1,900	1,850	1,805	1,760	1,710	1,665	1,620
	1	0	0	1	1,950	1,905	1,860	1,820	1,775	1,735	1,690	1,650
	0	1	0	1	2,075	2,030	1,990	1,945	1,900	1,855	1,810	1,770
	1	1	0	1	2,125	2,085	2,040	2,000	1,955	1,910	1,870	1,825
	0	0	1	1	2,170	2,130	2,090	2,045	2,005	1,965	1,925	1,880
	1	0	1	1	2,215	2,180	2,140	2,105	2,070	2,035	2,000	1,965
	0	1	1	1					2,225	2,165	2,100	2,040
	1	1	1	1						2,170	2,120	2,065

NOTES:

1. Motor switch settings for heating speeds use HEAT switches 1, 2, 3, & 4 and for cooling speeds use COOL switches 5, 6, 7, & 8.
2. To comply with government mandated efficiency standards, two openings are required for airflows above 1,600 CFM.
3. Data is shown without filter.
4. Temperature rises in the table are approximate. Actual temperature rises may vary.
5. Individual cells shaded in gray indicate a temperature rise outside of the recommended range.
6. To comply with government mandated efficiency standards, speed settings shaded in gray are not allowed in HEAT mode.
7. When in low stage heat, the airflow is approximately 70% of the tables high value (2-stage furnaces only).

ACCESSORIES

FG7TE Kits

Description	SKU
2" Concentric Vent Kit (US and Canada Approved)	904952
3" Concentric Vent Kit (US and Canada Approved)	904953
2" Side Wall Vent Kit	904617
3" Side Wall Vent Kit	904347
U.S. LP Conversion Kit (0 to 10,000 ft.)	905028
Canada LP Conversion Kit (0 to 4,500 ft.)	905029
Bottom Return Filter 20 per Box, "B" Cabinet	904916
Bottom Return Filter 20 per Box, "D" Cabinet	904918
Side Return Filter Kit	541036
Neutralizer Kit	902377

GENERAL TERMS OF LIMITED WARRANTY

Nordyne, LLC will furnish a replacement for any part of this product which fails in normal use and service within the terms and conditions of the warranty.

For complete details of the Limited Warranty, including applicable terms and conditions, see your local installer or contact the Nordyne, LLC warranty department for a copy.



DISCOVER Comfort

GET STARTED AT **FRIGIDAIREHVAC.COM**

GAS-FIRED c UL us LISTED

NORTH AMERICAN TECHNICIAN EXCELLENCE NATE CERTIFYING THE FINEST IN HVACR

AHRI CERTIFIED www.ahridirectory.org Residential Furnaces DOE 10 CFR Part 430

Member NAHB

HRAI MEMBER COMPANY

Before purchasing this appliance, read important energy cost and efficiency information available from your retailer. Specifications and illustrations subject to change without notice and without incurring obligations. Printed in U.S.A (06/24)

FRIGIDAIRE is a registered trademark of Electrolux Home Products Inc. and used under a license from Electrolux Home Products, Inc.

© Nordyne, LLC 2024. All Rights Reserved.

983F-0624

FRIGIDAIRE®

TOTAL PACKAGE